
DEKRA 16ATEX0002 X; IECEx DEK 16.0011 X

Applied standards: ATEX: EN 60079-0 : 2012+ A11:2013

EN 60079-1:2014

IECEx: IEC 60079-0: 2011+ Cor.2012+ Cor.2013

IEC 60079-1:2014

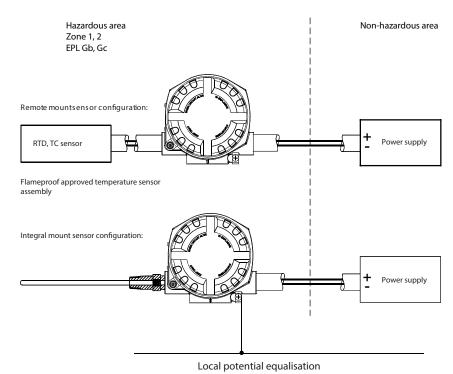

Type Electrical Data 662 HART* -protocol $U \le 40 \text{ V dc}$ $P \le 3 \text{ W}$

CategoryType of protection (ATEX)TypeII2GEx db IIC T6...T4 Gb662

Type of protection (IEC)Ex db IIC T6...T4 Gb

662

 Type
 Temperature class
 Ambient Temperature

 662
 T6
 $-40 \,^{\circ}\text{C} \le \text{Ta} \le +55 \,^{\circ}\text{C}$

 T5
 $-40 \,^{\circ}\text{C} \le \text{Ta} \le +70 \,^{\circ}\text{C}$

 T4
 $-40 \,^{\circ}\text{C} \le \text{Ta} \le +80 \,^{\circ}\text{C}$

Safety instructions:

Installation

- Comply with the installation and safety instructions in the Operating Instructions.
- Install the device according to the manufacturer's instructions and any other valid standards and regulations (e.g. IEC 60079-14).
- The housing of field transmitter must be connected to the potential matching line.
- Only the approved wire entries as specified in paragraph 10.3 of IEC60079-14, paragraph 16 of IEC 60079-0, paragraph 13 of IEC 60079-1 must be used.
- For connection through a conduit entry approved for this purpose the associated sealing facility shall be mounted directly to the housing.
- Seal unused entry glands with approved sealing plugs that correspond to the type of protection.
- For operating the transmitter housing at an ambient temperature under -20 °C, appropriate cables and cable entries permitted for this application must be used.
- For ambient temperatures higher than +70 °C, use suitable heat-resisting cables or wires, cable entries and sealing facilities for Ta +5K above surrounding.
- During operation, the cover must be screwed all the way in and the cover's safety catch must be fastened.
- The remote or integral mounted temperature sensor must comply with the requirements according to IEC 60079-1.
- The flameproof joints are not intended to be repaired.

Safety instructions:

Special conditions

- Use for remote temperature sensors only approved sensors certified for category II2G marked not less than II2G Ex d IIC T6...T4 Gb for use in Zone 1.
- Use for integral temperature sensors only approved sensors certified for category 1G or 2G marked not less than II1/2G Ex d IIC T6...T4 Ga/Gb or II2G Ex d IIC T6...T4 Gb for use in Zone 0 resp. Zone 1.
- The temperature class specified for the certified temperature sensor shall be taken into account.
- The transmitter must be installed so, that even in the event of rare incidents, an ignition source due to impact or friction between the enclosure and iron/steel is excluded.

- Warning!

Do not open the electrical connection of the power supply circuit in an explosive atmosphere.

TITLE:			PART NUMBER:	DATE:	
662 Safety Instructions	(G)			07/10	/2019
This document is PROPRIETARY to Pyromation, Inc.		SIZE:	DRAWING NO:	REV:	SCALE:
		Α	M009501	Α	N/A

